



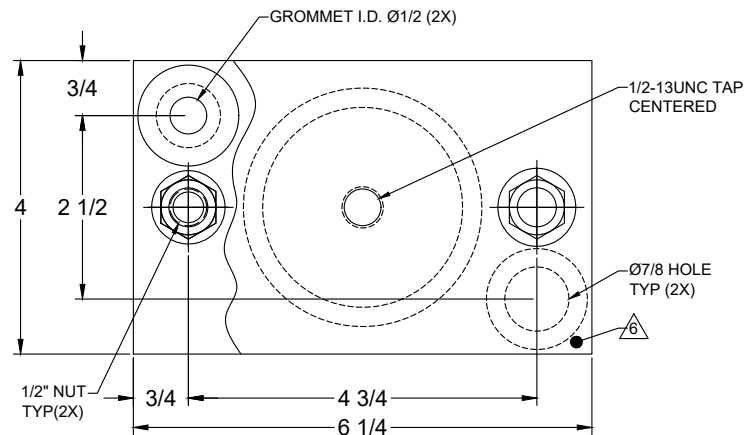

SECTION A-A

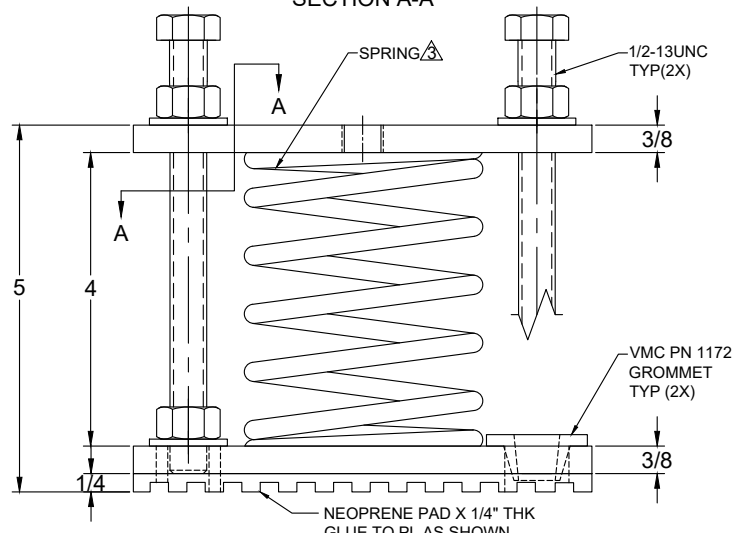


NOTES:

1. ALL DIMENSIONS ARE IN INCHES. INTERPRET PER ANSI Y-14.
2. HOUSING AND SPRING ONE COAT VMC GROUP BLACK FINISH, HARDWARE- ZINC ELECTROPLATE.
3. INNER SPRING NOT SHOWN.
4. ALL SPRINGS DESIGNED WITH NOMINAL 50% OVER-TRAVEL.
5. RATED DEFLECTIONS ARE WITHIN 25% OF NOMINAL. HIGHER DEFLECTIONS ARE ALLOWED IF THEY MEET SPECIFICATIONS.
6. STAMP/ TAG MARKING LOCATED ON TOP PLATE.

MODELS AWP-1E SPRING-FLEX ISOLATORS				
MODEL	MAX LOAD (LBS)	DEFLECTION (IN)	SPRING RATE (LB/IN)	SPRING COLOR CODE
AWP-1E-195	195	1.95	100	DK BLUE
AWP-1E-400	400	1.32	303	BLACK
AWP-1E-530N ¹	530	1.17	453	BLACK/ DK BLUE
AWP-1E-650	650	1.05	619	RED
AWP-1E-825N ¹	825	1.07	771	RED/ DK BLUE
AWP-1E-1000	1000	1.00	1000	TAN
AWP-1E-1200N ¹	1200	1.04	1154	TAN/ DK BLUE
AWP-1E-1400	1400	1.00	1400	PINK

NOTES:

1. TWO NESTED SPRINGS YIELD THIS LOAD. THE COLOR CODE IS FOR OUTER SPRING/ INNER SPRING.

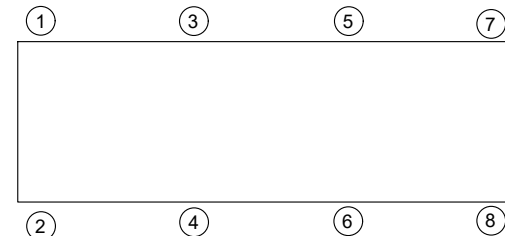

ISOLATOR SELECTIONS

LOC 1:	LOC 2:
LOC 3:	LOC 4:
LOC 5:	LOC 6:
LOC 7:	LOC 8:
CUSTOMER EQ'PT. TAG:	

NOTE: MATERIAL SHOWN IS FOR (1) SET.

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.



CERTIFIED FOR:

JOB NAME: _____
 CUSTOMER : _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

MODEL AWP-1E 195-1400 LBS
 PRE-COMPRESSED OPEN SPRING
 FLEX ISOLATORS
 1 INCH DEFLECTION




VMC GROUP
 CONTROLLED ENVIRONMENT SOLUTIONS™

Bloomington, NJ Houston, TX Corona, CA Wind Gap, PA

SCALE :	SHEET:	DRAWING NO.:	REVISION
NONE	1 OF 2		

REV.	DESCRIPTION	DATE	BY

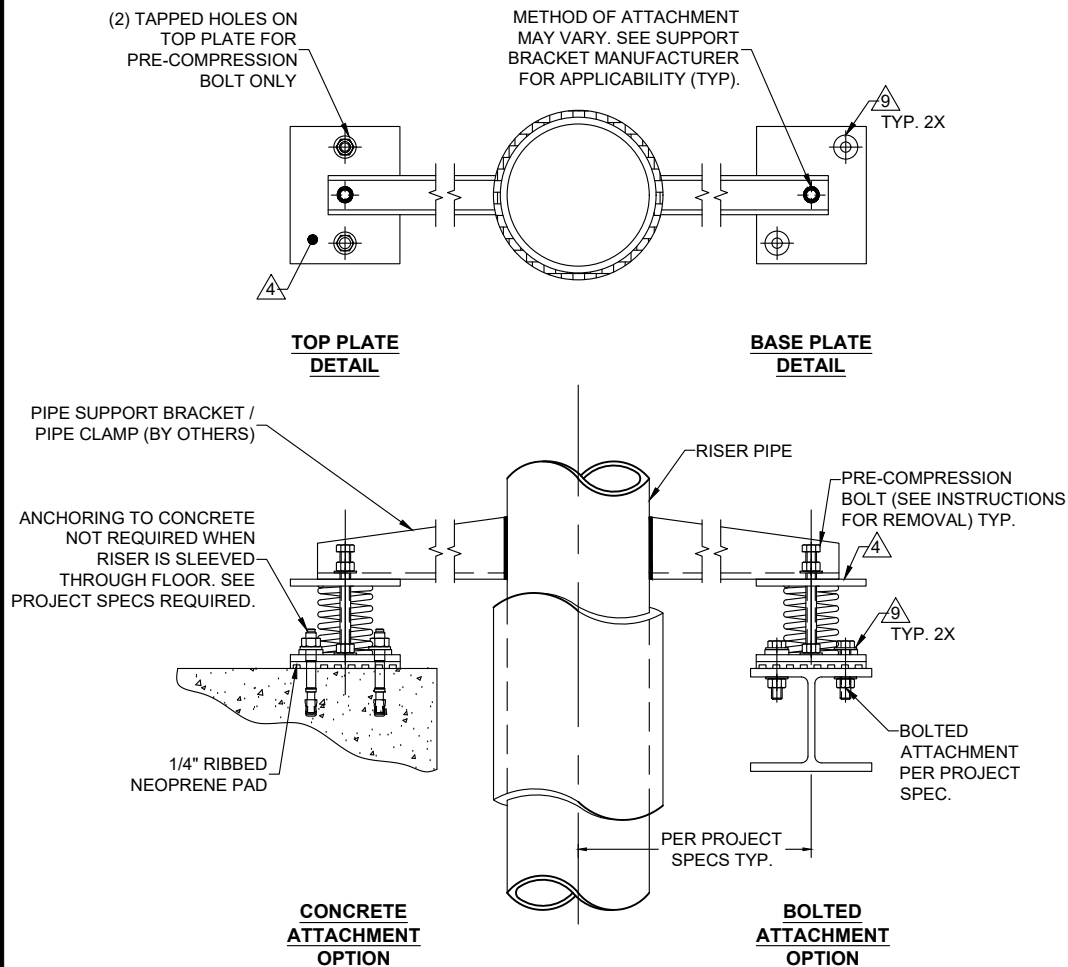**INSTALLATION INSTRUCTIONS**

1. READ INSTRUCTIONS IN THEIR ENTIRETY BEFORE BEGINNING INSTALLATION.

2. ISOLATORS ARE SHIPPED FULLY ASSEMBLED AND MUST BE SPACED AND ARRANGED IN ACCORDANCE WITH PROJECT SPECIFICATION OR AS OTHERWISE RECOMMENDED.

3. SET ISOLATORS ON THE FLOOR OR SUB-BASE, ENSURING THAT ALL ISOLATOR CENTERLINES MATCH THE SUPPORT BRACKET MOUNTING HOLES OR SPACE AND ARRANGE ISOLATORS IN ACCORDANCE WITH THE PROJECT SPECIFICATION. SHIM OR GROUT AS REQUIRED, LEVELING ALL ISOLATOR BASE PLATES TO THE SAME ELEVATION (A 1/4" MAXIMUM DIFFERENCE IN ELEVATION CAN BE TOLERATED). THE ISOLATOR BASE MUST REST ON A FLAT SURFACE.

4. DESIGNATION OF ISOLATORS IS INDICATED ON THE STAMPED/ TAGGED MARKING LOCATED ON TOP PLATE.

5. DO NOT REMOVE PRE-COMPRESSION BOLTS UNTIL PIPE IS AT FULL OPERATING WEIGHT. REMOVE COMPRESSION BOLT AT AMBIENT TEMPERATURE BEFORE HEATING OR COOLING THE FLUID.

6. IT IS IMPORTANT THAT THE SUPPORT BRACKET BE INSTALLED AT THE PROPER HEIGHT. REFERENCE THE RISE DIAGRAM ENGINEERED BY VMC GROUP FOR THE ACTUAL HEIGHT. THE HEIGHT MAY DIFFER FOR DIFFERENT FLOORS. SEE THE RISER DIAGRAM FOR EACH FLOOR. (IT MAY BE EASIER TO MOUNT THE PIPE SUPPORT BRACKET ONTO THE ISOLATOR FIRST TO ALIGN THE BRACKET PROPERLY. REFER TO SUPPORT BRACKET SUPPLIER TO CONFIRM IF THIS IS POSSIBLE.)

7. ONCE THE BRACKET IS ALIGNED PROPERLY, WELD THE BRACKET TO THE PIPE. THE PIPE BRACKET MUST BE DESIGNED AND WELDED TO SUPPORT THE LOADS SPECIFIED IN THE VMC GROUP RISER DIAGRAM PER PROJECT.

8. FILL PIPE WITH FLUID BEFORE REACHING THE OPERATING TEMPERATURE. REMOVE PRE-COMPRESSION BOLTS. FURTHER ADJUSTMENTS ARE NOT REQUIRED. (DO NOT DISCARD PRE-COMPRESSION BOLTS, AS THEY MAY BE NEEDED IF FUTURE MAINTENANCE IS REQUIRED.)

9. IF FLOOR FASTENING IS REQUIRED, PLACE MOUNT AS INDICATED IN INSTALLATION INSTRUCTION 1 THRU 4 AND ANCHOR USING (2) THRU HOLES ON THE MOUNT BASE PLATE OR BOLT.

DRAIN INSTRUCTIONS

1. ALLOW THE RISER TO COME TO AMBIENT TEMPERATURE.

2. REINSTALL PRE-COMPRESSION BOLTS.

3. DRAIN THE RISER. (PRE-COMPRESSION BOLTS WILL HOLD RISER AT A CONSTANT HEIGHT.)

4. TO RE-FILL THE RISER, FOLLOW INSTALLATION INSTRUCTIONS INSTRUCTION 8.

NOTES:

1. SEE PROJECT SPECS FOR ANCHORING REQUIREMENT IF APPLICABLE.

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

**CERTIFIED FOR:**

JOB NAME: _____

CUSTOMER: _____

CUSTOMER P.O.: _____

SALES ORDER: _____

MODEL AWP-1E 195-1400 LBS
PRE-COMPRESSED OPEN SPRING
FLEX ISOLATORS
1 INCH DEFLECTION



VMC GROUP
CONTROLLED ENVIRONMENT SOLUTIONS™

Bloomington, NJ Houston, TX Corona, CA Wind Gap, PA

SCALE:	SHEET:	DRAWING NO.:	REVISION
NONE	2 OF 2		