


REV.	DESCRIPTION	DATE	BY

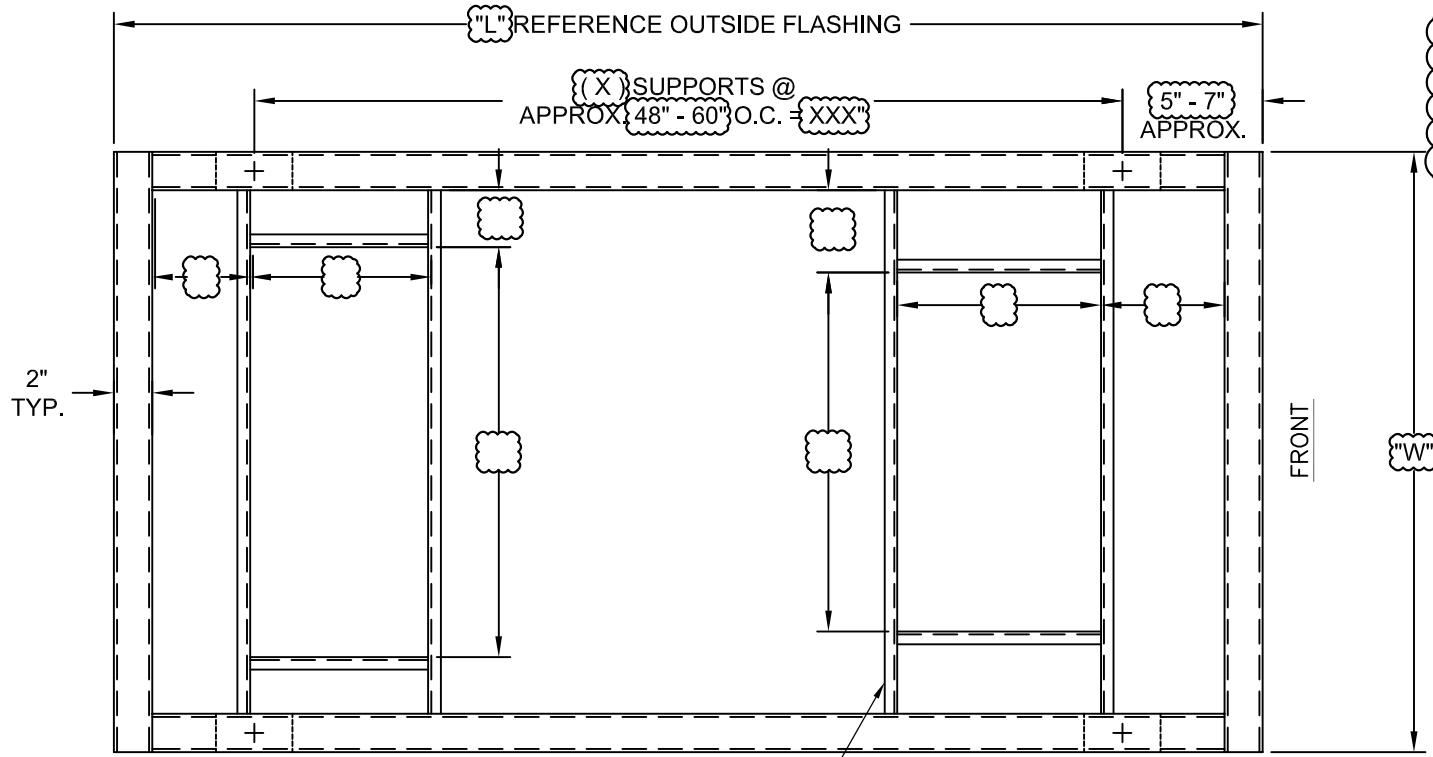

CURB DATA
 TOTAL CURB WEIGHT: _____ 14 LB/FT
 QUANTITY: _____ SHIPPED IN _____ 1 SECTION(S)
 LOWER RAIL O.A. DIMENSIONS: _____ L x W
 CURB HT: _____ 14" COND. RAIL HT: _____
 CURB LINEAL FOOTAGE: $(L \times 2) + (W \times 2)$

TYP. DUCT SUPPORTS AS REQUIRED
 FLUSH TO TOP; DROP 'Y' INCHES

OPTIONS

YES	NO	
<input type="checkbox"/>	<input type="checkbox"/>	SEISMIC/WIND CONSIDERATION
<input type="checkbox"/>	<input type="checkbox"/>	SOUND BARRIER PKG.
<input type="checkbox"/>	<input type="checkbox"/>	CONDENSING UNIT RAIL PER DWG. _____
<input type="checkbox"/>	<input type="checkbox"/>	DUCT SUPPORT PKG.

TAG: _____
 MANUFACTURER: _____
 MODEL NUMBER: _____
 OPERATING WEIGHT: _____

NOTE: ENGINEER REQUIRED TO FILL IN ALL VARIABLES PRIOR TO SUBMISSION. IF ANY VARIABLES ARE MISSING, MARK DWG AS "PRELIMINARY" AND SUBMIT. REMOVE BALLOONS AND THIS NOTE.

- NOTES:
1. ROOFING AND INSULATION TO BE SUPPLIED AND INSTALLED BY OTHERS.
 2. OUTSIDE DIMENSIONS OF CURB MATCH UNIT MANUFACTURERS CURB.
 3. FOR MANUFACTURING DETAILS, REFERENCE SUBSEQUENT DRAWING SHEETS.

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:
 JOB NAME: _____
 CUSTOMER: _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

MODEL P-6000S NON ISOLATED SEISMIC WIND RESTRAINT ROOF CURB



SCALE: NONE	Member VISCMA
SHEET:	
DRAWING NO.:	REVISION